



PLAN-76th FL.-SS-75S

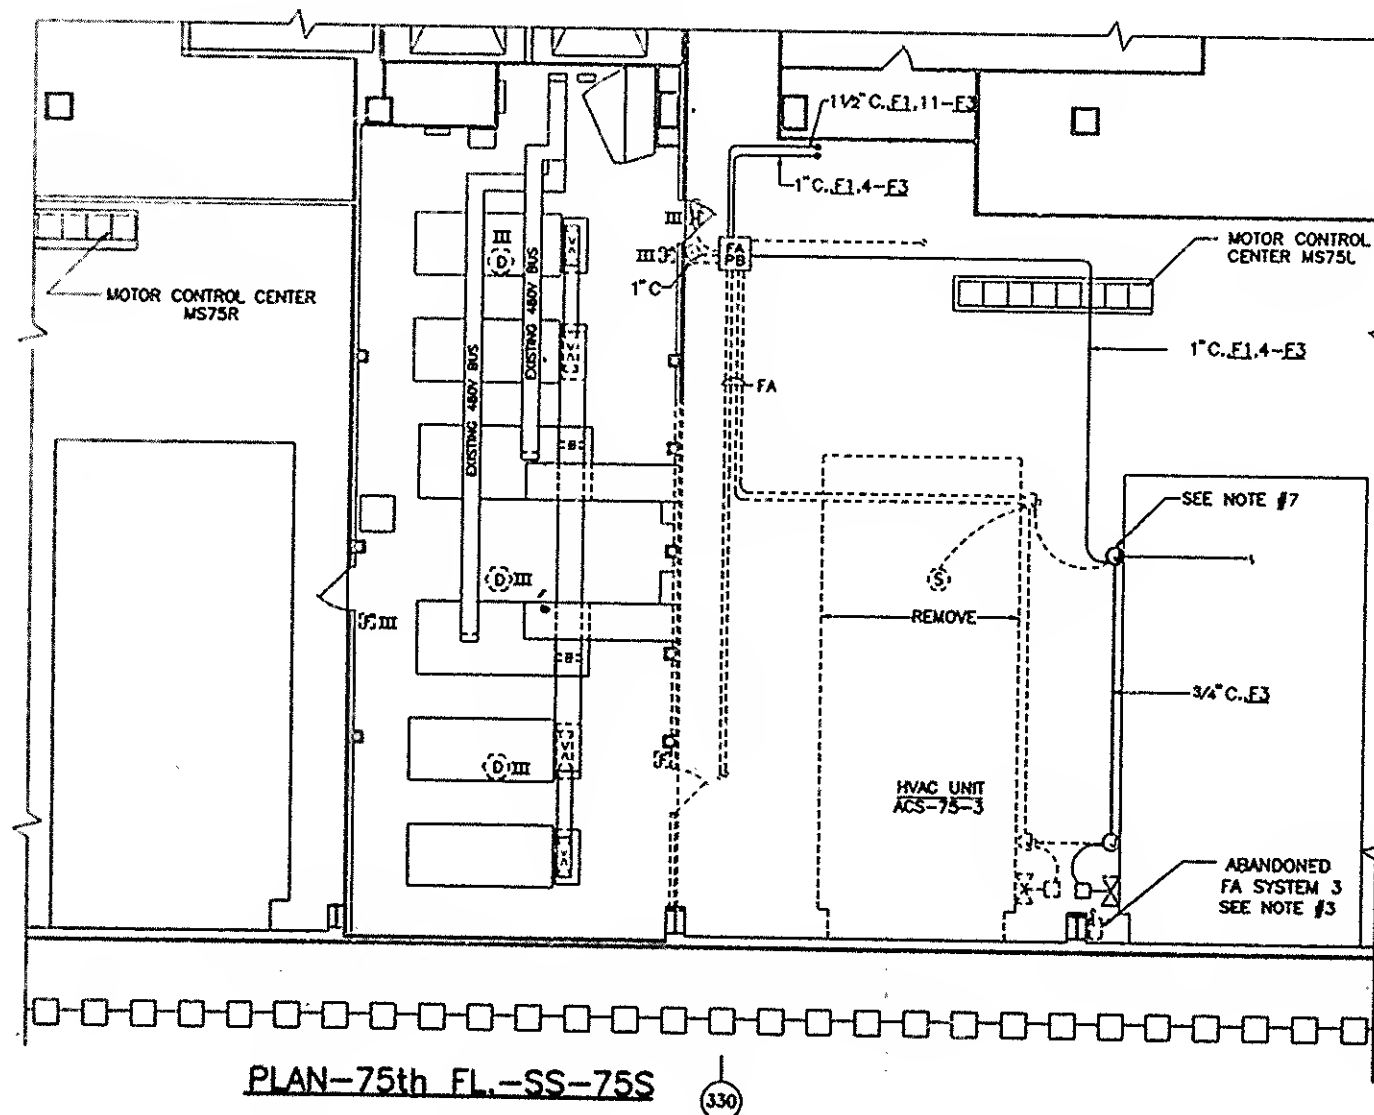

PLAN-75th FL.-SS-75S

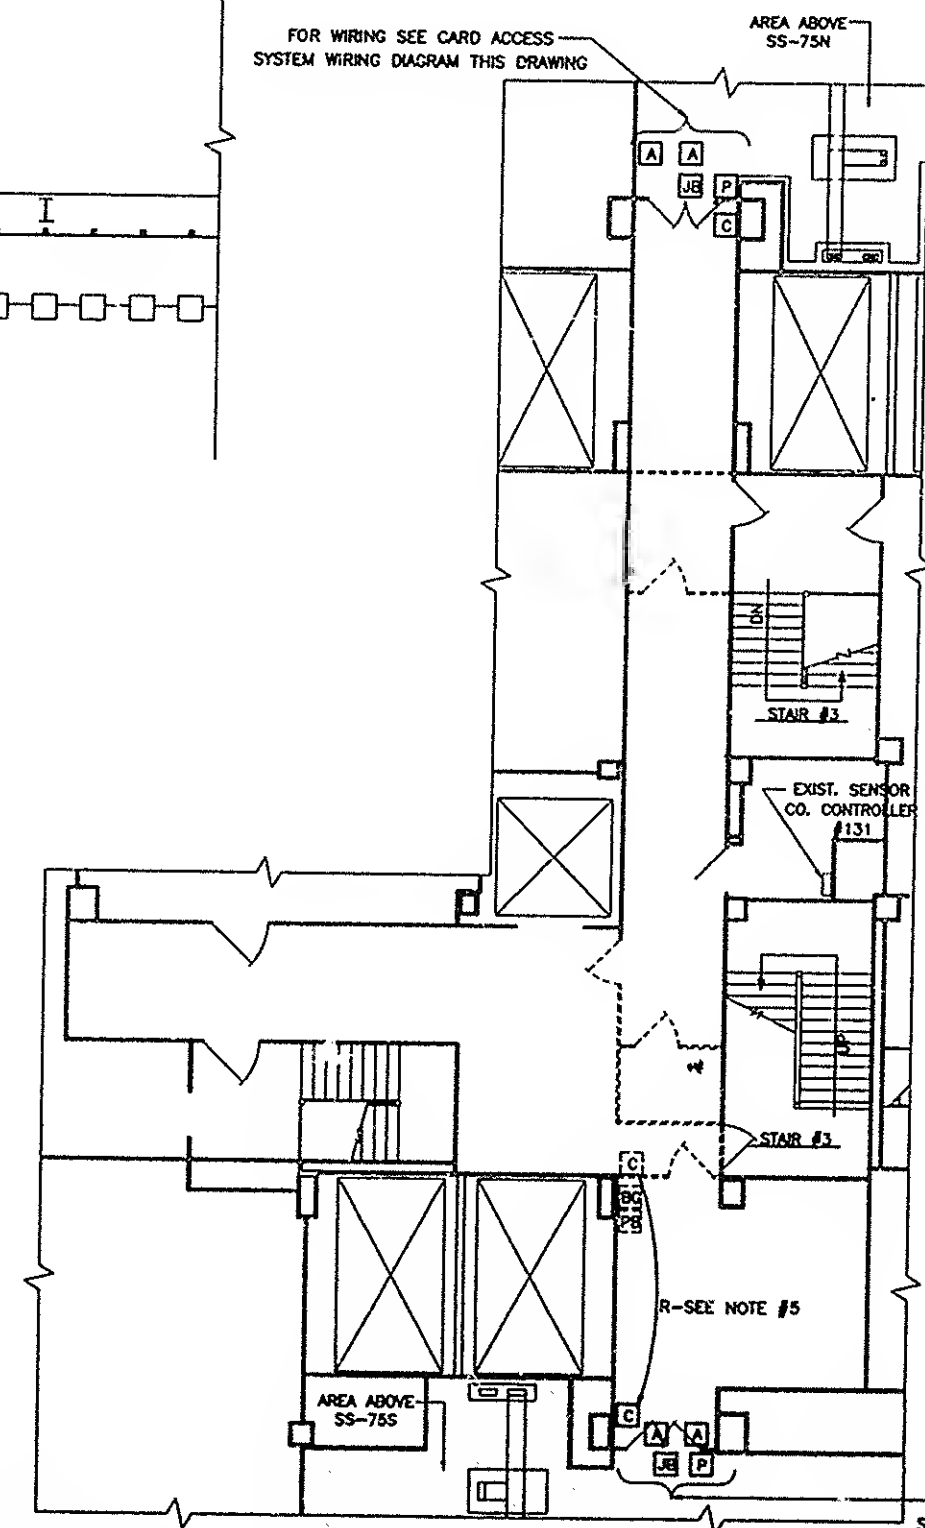

PART PLAN "A"--76th FLOOR

NOTES

1. FOR LEGEND SEE DWG. #E-1, FOR GENERAL AND LIGHTING FIXTURE SCHEDULE SEE D-1
2. FOR TYPICAL SUBSTATION STAGE I SEE DWG. #E-2
3. REMOVE ABANDONED FIRE ALARM SYSTEM
4. RELOCATE EXISTING CARD READER AND IN EXTEND EXISTING CONDUIT AND WIRING AS ACCORDANCE WITH CARD ACCESS SYSTEM ALL DEVICES FOR CARD ACCESS SYSTEM SHALL BE INSTALLED BY CONTRACTOR.
- CONTRACTOR SHALL FURNISH AND INSTALL A READER SYSTEM AS SHOWN ON DWG.
- CONTRACTOR SHALL PROVIDE THE FOLLOWING: (a) PANELED PUSH-BUTTON (b) STRIKE RELEASE DOOR ENTRY, ANY FORCED DOOR ENTRY NOT TO SYSTEM PC.
5. CONNECT NEW CARD READER TO EXIST. C.
6. 2#18 CABLE SHALL BE TIEFON JACKETED #522 CABLE SHALL BE SHELDED, TIEFON
7. INTERCEPT AND REROUTE EXISTING WIRING INSTALLATION, PROVIDE JUNCTION BOX AT WIRE IN REROUTED CONDUIT SECTION AS IN JUNCTION BOXES.